



# **GEOTECHNICAL REPORTS AND HOW TO MAKE SENSE OF THEM**

**A Seminar Presentation by  
Panos D. Kiouisis, Ph.D.**

**<http://www.qsystemsengineering.net/>**

---

---



# Contents of a Geotechnical Report

<http://www.qsystemsengineering.net/>

Q SYSTEMS ENGINEERING LLC

- **Contents vary depending on goals, size of project, types and importance of structures, etc.**
  - **A geotechnical report is expected to include some or all of the following:**
    - **Summary Geology of the site**
    - **A plan of field investigation**
      - **Boreholes**
      - **Drilling into bedrock**
      - **Test Pits**
      - **Other**
    - **Index Testing**
      - **Sieve analysis**
      - **Atterberg Limits**
      - **Classification**
- 
-

# Contents of a Geotechnical Report

## *Continued*



<http://www.qsystemsengineering.net/>

Q SYSTEMS ENGINEERING LLC

- **Laboratory Testing**
    - **Strength Tests**
      - Material Parameters ( $c, \phi$ )
    - **Compressibility Tests**
      - Modulus of elasticity
      - Compression and recompression index
    - **Swelling Tests**
      - Swelling index
      - Swelling pressure
    - **Chemical Tests**
      - Sulfates
      - Chlorides
      - pH
  - **Seismic Characteristics**
- 
-

# Contents of a Geotechnical Report

## *Continued*



<http://www.qsystemsengineering.net/>

Q SYSTEMS ENGINEERING LLC

- **Shallow footings**
    - **Allowed pressures**
    - **Maximum Settlements**
    - **Often missing from the Geotechnical Reports:**
      - **Effects of depth of embedment**
      - **Effects of footing size**
      - **Effects of load inclination**
      - **Effects of load eccentricity**
      - **Seismic effects**
  
  - **Pile foundations**
    - **Recommended minimum length and cross-section**
    - **Allowed axial loads**
    - **Settlement (some times)**
    - **Often missing from the Geotechnical Reports:**
      - **Lateral load bearing capacity**
- 
-

# Contents of a Geotechnical Report

## *Continued*



<http://www.qsystemsengineering.net/>

Q SYSTEMS ENGINEERING LLC

- **Other information that is often missing**
  - **Factors of safety that were used for the pressure and load recommendations**
  - **Description of the basis of design**
  - **Justification of the recommendations**
  - **IN OTHER WORDS: NO CALCULATIONS PACKAGE**



- **Issues**
    - **Recommendations are often unsubstantiated;**
    - **Thus, the user of a geotechnical report cannot always verify the validity of the recommendations.**
    - **Unsubstantiated reports handicap the QA/QC processes of the firm that produces them, AS WELL AS the engineers that use them.**
    - **Geotechnical Engineering is based much more on Standard Engineering Practice rather than Codes. Thus, a common reference is naturally missing.**
    - **Structural Engineers often feel insecure of their knowledge and understanding of Geotechnical Engineering. As a result:**
      - **They may accept the report recommendations without demanding full justification of the recommendations.**
      - **They may use the results without firm confirmation as to whether they should compare the recommended capacities to factored OR unfactored loads.**
      - **They may accept the results without being fully aware that allowed pressure of 3000 psf on a 5 ft. x 5 ft. footing does not imply the same settlement as 3000 psf on a 10 ft. x 10 ft. footing!**
-

# Evaluation of Recommendations

## *Continued*



<http://www.qsystemsengineering.net/>

Q SYSTEMS ENGINEERING LLC

- **Should we verify the Geotechnical Report Recommendations?**
    - Trust **BUT** verify.
    - Geotechnical Engineers are often very conservative.
    - At times, geotechnical reports received from the same company on different sites appear to be suspiciously similar.
    - *It is understood that a Structural Engineer cannot, and should not, be expected to reproduce the recommendations of a geotechnical report. However, as will be discussed later, there are some common sense checks to verify that, at least, the recommendations are reasonable.*
    - Geotechnical Engineers have developed the culture that if their evaluations are higher than the ones specified by IBC, they cannot be correct, OR that using higher values results in unacceptable liability on their part
- 
-

# Evaluation of Recommendations

## Continued



<http://www.qsystemsengineering.net/>

Q SYSTEMS ENGINEERING LLC

Here are the presumptive load-bearing values from IBC, followed by the instruction for use (article 1806.2)

TABLE 1806.2  
PRESUMPTIVE LOAD-BEARING VALUES

CLASS OF MATERIALS	VERTICAL FOUNDATION PRESSURE (psf)	LATERAL BEARING PRESSURE (psf/ft below natural grade)	LATERAL SLIDING RESISTANCE	
			Coefficient of friction <sup>a</sup>	Cohesion (psf) <sup>b</sup>
1. Crystalline bedrock	12,000	1,200	0.70	—
2. Sedimentary and foliated rock	4,000	400	0.35	—
3. Sandy gravel and/or gravel (GW and GP)	3,000	200	0.35	—
4. Sand, silty sand, clayey sand, silty gravel and clayey gravel (SW, SP, SM, SC, GM and GC)	2,000	150	0.25	—
5. Clay, sandy clay, silty clay, clayey silt, silt and sandy silt (CL, ML, MH and CH)	1,500	100	—	130

For SI: 1 pound per square foot = 0.0479 kPa, 1 pound per square foot per foot = 0.157 kPa/m.

a. Coefficient to be multiplied by the dead load.

b. Cohesion value to be multiplied by the contact area, as limited by Section 1806.3.2.

**1806.2 Presumptive load-bearing values.** The load-bearing values used in design for supporting soils near the surface shall not exceed the values specified in Table 1806.2 unless data to substantiate the use of higher values are submitted and *approved*.



# Evaluation of Recommendations

## *Continued*



<http://www.qsystemsengineering.net/>

Q SYSTEMS ENGINEERING LLC

- The table 1806.2 of the previous slide was taken from IBC 2012. However, it is the same (or very similar) to the recommendations of preceding, as well as subsequent, versions of IBC.
- A careful read of article 1806.2 (also in the previous slide) indicates that these values are not to be exceeded *UNLESS* data to substantiate the use of higher values are submitted and approved.
- Through the years, it appears that many geotechnical engineers pay no credence to the “*data to substantiate the use of higher values*” part of this statement.
- This IBC statement means that valid test data and accepted analytical tools may be used to allow the engineer to use higher (*or even lower*) bearing capacity values.
- It should be noted that decisions on allowed bearing loads **SHOULD NOT** be made without establishing the following:
  - What is the size of the footing?
  - What is the shape of the footing (square, rectangular, long)?
  - What is the depth of embedment?
  - What is the allowed settlement?

# Evaluation of Recommendations

## *Reality Check*



<http://www.qsystemsengineering.net/>

Q SYSTEMS ENGINEERING LLC

- **So, what are some common sense checks on the validity of the provided recommendations?**
    - **Your vehicle (sedan) drives on tires which are inflated to approximately 30 psi. Your SUV tires are typically inflated to higher pressures (in the order of 40 psi)**
    - **This means that your sedan tires apply a pressure on the ground, which is equal to 30 psi. Similarly, your SUV tires apply a pressure of 40 psi on the ground.**
    - **30 psi is 4320 psf**
    - **An allowed pressure of 1500 psf implies that you cannot drive your vehicle over that space, or even if you can, the tire will sink into the ground, leaving very deep marks.**
    - **A construction truck has tires with pressures anywhere between 80 and 100 psi (11500 to 14400 psf). How will these trucks access a site with an allowed bearing pressure of 1500 psf?**
  - **Since experience indicates that we can certainly drive our vehicles over such space, and we can drive our construction trucks during construction, what are we to conclude about the allowed pressure of 1500 psf?**
- 
-

# Evaluation of Recommendations

## *Reality Check - Continued*



<http://www.qsystemsengineering.net/>

Q SYSTEMS ENGINEERING LLC

- **Bearing capacity is typically evaluated based on some variation of Terzaghi's equation:**
    - $q_u = cN_c + \gamma D_f N_q + \frac{1}{2} \gamma B N_\gamma$
    - $q_u = \gamma D_f N_q + \frac{1}{2} \gamma B N_\gamma$  if we ignore cohesion.
  - **For  $\phi = 30^\circ$  (loose sand), and depth of embedment of 4 ft, a square footing with width 5 ft. and soil density 100 pcf, the above equation produces an allowed bearing pressure of 5700 psf based on a factor of safety of 3. The corresponding settlement is 1.45 in. using calculations based on Schmertmann's theory.**
  - **The above allowable pressure is reduced to 4200 psf if the settlement is to be reduced to 1.00 inch.**
  - **For the same conditions, a LONG footing, restricted to 1 inch of settlement, has an allowed bearing pressure of 2500 psf!**
  - **Is it proper to recommend an allowed pressure of 2500 psf and ignore the 4200 psf? As a structural engineer would you not rather have the distinction between the square and long footing explicitly stated?**
- 
-

# Evaluation of Recommendations

## *Reality Check - Continued*



<http://www.qsystemsengineering.net/>

Q SYSTEMS ENGINEERING LLC

- For  $\phi = 35^\circ$  (medium dense sand), and depth of embedment of 4 ft, a square footing with width 5 ft. and soil density 100 pcf, and a restricted settlement of 1 in. results in an allowed bearing pressure of 8300 psf.
  - For the same conditions, a long footing restricted to 1 inch of settlement has an allowed bearing pressure of 4800 psf!
  - When was the last time that you saw a geotechnical report with a recommended allowed pressure of 8300 psf for square footings that were not placed on rock?
  - If you review your old geotechnical reports you will often find a disconnect between the tested friction angle  $\phi$  and allowed bearing pressure.
  - It is not unreasonable to ask justification for the recommendations presented in the geotechnical report.
- 
-

# Evaluation of Recommendations


## *Reality Check - Continued*



<http://www.qsystemsengineering.net/>

Q SYSTEMS ENGINEERING LLC

As can be seen here, from the Caltrans manual, a friction angle of 30 degrees corresponds to SPT blow counts, corrected for depth, between 5 and 10 (ignoring the less conservative upper range of values).

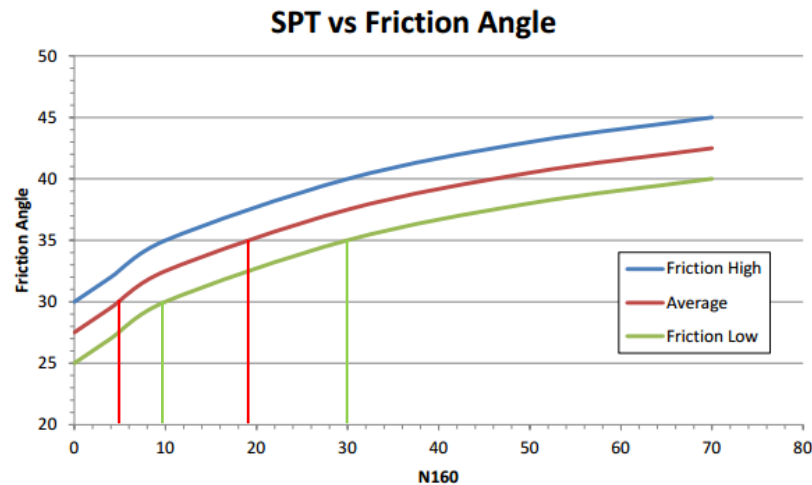

# Evaluation of Recommendations


## Reality Check - Continued



<http://www.qsystemsengineering.net/>

Q SYSTEMS ENGINEERING LLC

- Similarly, from the chart below, a clay of medium plasticity with an SPT blow-count of 10 has an unconfined compression strength  $q_u = 1.5 \text{ tsf} = 3000 \text{ psf}$  based on Terzaghi and Peck recommendations. This is equivalent to an undrained shear strength  $s_u = 1500 \text{ psf}$ .
- For this soil, and depth of embedment of 4 ft, a square footing with width 5 ft. has an allowed bearing pressure of 2800 psf based on allowed settlement of 1.00 in. The corresponding factor of safety against failure is 4. The numbers are better for a low plasticity clay or silt.

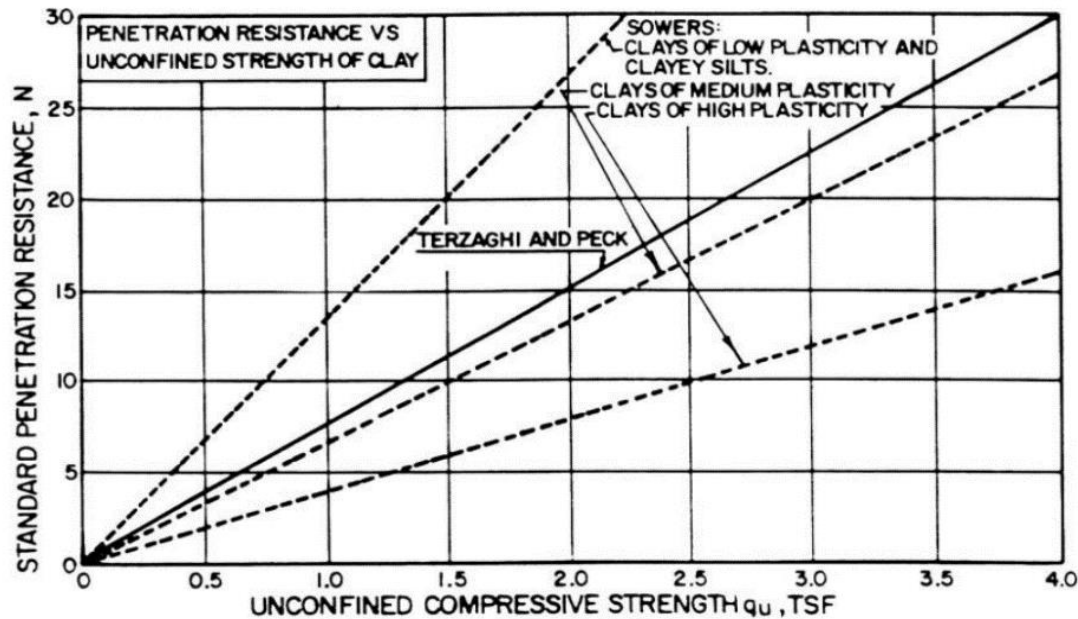

- **Geotechnical reports represent the experiences of the Geotechnical Engineers that have prepared them.**
  - **HOWEVER, geotechnical reports may also represent the most conservative instincts of the Geotechnical Engineer, and may offer unnecessarily expensive solutions IF these recommendations are unchallenged.**
  - **Geotechnical Engineers tend to provide recommendations based on their past experiences on similar soils, and may skip essential testing. HOWEVER, conditions are not always as similar as they appear.**
  - **The ability of the Structural or Geotechnical Engineer to independently verify, or at least make sense of the recommendations of the geotechnical report is thus essential.**
-

# In Conclusion

## *Continued*



<http://www.qsystemsengineering.net/>

Q SYSTEMS ENGINEERING LLC

- **The difficulty of verification effort increases in this order:**
    - Allowable pressures of shallow footings
    - Evaluation of settlements of shallow footings, although in MOST cases a factor of safety of 3 may be sufficient to limit settlements to acceptable values (often 1 in.)
    - Swelling pressure and minimum pressure of a shallow footing in swelling soils
    - Allowed axial capacity of piles and drilled shafts
    - Evaluation of settlements of piles and drilled shafts
    - Evaluation of the ability of piles and drilled shafts to resist uplift in swelling soils
    - Capacity of piles to resist lateral loads
    - Pile groups under axial compression
    - Pile groups under lateral forces
    - Flexible retaining structures
    - Slope Stability
  - **Geotechnical software, such as Geotech Master™ (<http://qsystemsengineering.net/default.html>), when used properly, can be very helpful on the effort to achieve proper, safe, yet economical, designs.**
- 
-